


CODE KEY

instrument cable

Example:

<u>P</u>	<u>/</u>	<u>ALM</u>	<u>/</u>	<u>AL</u>	<u>P</u>	<u>W</u>	<u>P</u>	<u>TW</u>	<u>K</u>	<u>-</u>	<u>12</u>	<u>-</u>	<u>20F</u>	<u>-</u>	<u>BX</u>	<u>(triad)</u>	<u>600V</u>
1		2		3	4	5	6	7	8		9		10		11	12	13

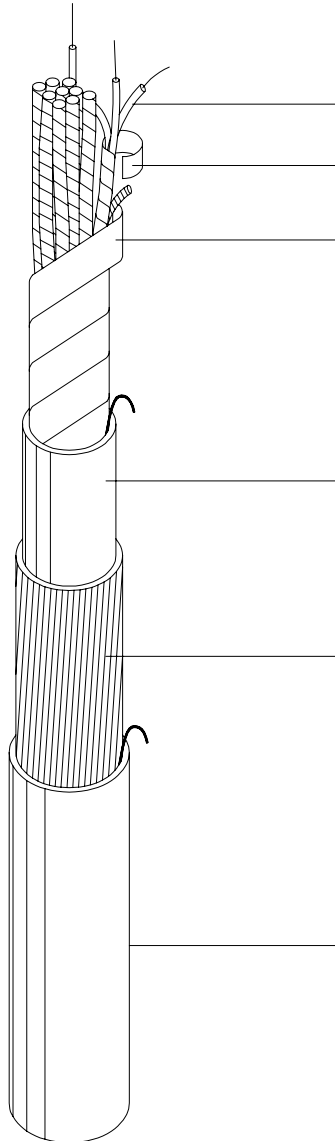

- 1 Conductor insulation PVC (P) (UP)
- 2 Individual shield + drain wire
- 3 Overall shield + drain wire
- 4 PVC inner jacket (optional)
- 5 Galvanized steel wire armour (optional)
- 6 PVC outer jacket
- 7 Twisted conductors
- 8 Cable (more than 1 pair or triad)
- 9 No. of pairs or triads (on datasheet □, example: 12)
- 10 Conductor size in AWG (F for multi-stranded)
- 11 Copper conductors (paired)
- 12 Triad - to be specified when required
- 13 600V - to be specified when required (300V standard rating)



Thermo Electric
P.O. Box 179
2740 AD Waddinxveen
The Netherlands

Tel. : +31 (0)182 – 302 850
 Fax : +31 (0)182 – 302 777
 E-mail : info@thermo-electric.nl
 Internet: http://www.thermo-electric.nl

G/002
Rev.00 08/03